

AHU3, 03-04-04, 4-10 am

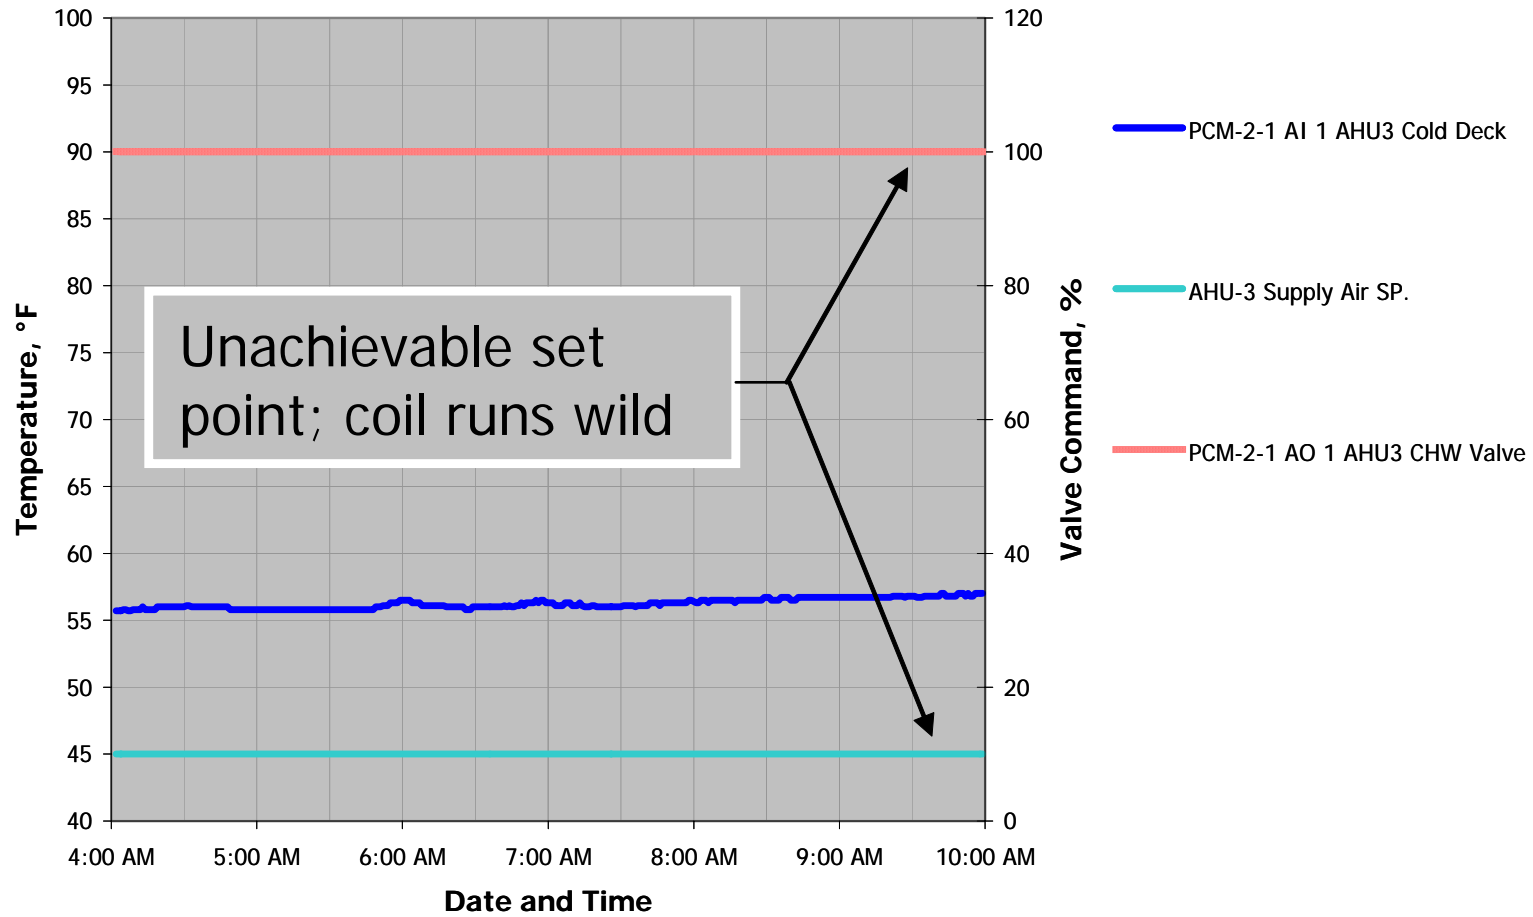


Figure 14 – An AHU set point problem that will impact the chilled water system which will in turn, impact the other AHUs on the site as well as the triggering AHU.